

INSTALLATION MANUAL



Adjustable Pitch Fan Assembly 34' & 36' Diameter

Hudson Tuf-Lite II[®] fan blades

Hudson Tuf-Lite II[®] (white, prev. blue***) fan blades are made from fiberglass reinforced vinyl-ester resin having a very high strength-to-weight ratio and superior ultra-violet and corrosion resistance. An elastomeric blade/holder joint cover (not shown) prevents moisture from entering the blade (shown above).

The individually balanced blades can be replaced independently - matched sets are not required.

RECOMMENDED TOOLS

- Long T-Handle Allen Wrench Set (3/16" to 3/8")
- Medium Size Flat Head Screw Driver
- Brass Ball Peen Hammer
- Flat Bastard File
- 240 Grit Sand Paper
- Anti-Seize Lubricant
- WD-40
- 12" Crescent Wrench

- Shop Towels
- Exact-A-Pitch[®] Digital Protractor (P/N 62375)
- 25 ft. Measuring Tape
- Pencil or Marker
- Open/Box End Wrench Set (1/2" 1-5/8")
- Socket Set for 1/2" Drive (1/2" 1-5/8")
- Torque Wrench(s) Rated for 0-300 ft-lb.

INSTALLATION PROCEDURES

ASSEMBLY WITH BUSHING

Clean all mating surfaces between hub, bushing and shaft. If there is no shoulder on shaft to prevent bushing from sliding down shaft, slide spacer/sleeve (not provided) on shaft before bushing. Slide bushing and key onto shaft until flush with end of shaft. Lock W-2 bushing on shaft by tightening set screw in flange with 1/4" Allen Wrench. (Note: set screw is not present on all bushings) Line up key and set hub on bushing. Engage the four (4) 3/4" cap screws in flange of bushing into hub spool. Using a torque wrench with a 1-1/8" socket, tighten evenly to recommended standard of 250 ft-lb (dry).

ASSEMBLY WITH STRAIGHT SHAFT (NO BUSHING)

Clean all mating surfaces between the hub and the shaft. If there is no shoulder on shaft to prevent hub from sliding down shaft, slide spacer/sleeve (not provided) on shaft before hub or use a thrust retainer (optional equipment) on top of hub. Install key in shaft. Line up key and keyway and set hub on shaft. Tighten two (2) set screws in hub.

ASSEMBLY WITH TAPERED SHAFT (NO BUSHING REQUIRED)

Clean all mating surfaces between hub and shaft. Coat all mating surfaces with an anti-seize or lubricating compound.

Align keyways and set hub onto shaft. Install retainer plate and cap screw(s) with lock washer(s). Shaft size determines what size cap screw is necessary. Using a torque wrench with a socket, evenly tighten cap screw to recommended standard per table below.

Cap Screw	Socket	Torque Value (ft-lb)							
Size	Size	Lubricated	Dry						
5/8" NC	15/16"	100	110						
3/4" NC	1-1/8"	125	130						
1" NC	1-1/2"	150	160						

NOTE: Retaining arrangement varies with gear shaft design.

ASSEMBLE BLADE CLAMP ON BLADE NECK

Remove blade clamp studs, lock washers, and blade clamp halves from hub. Assemble blade clamp halves over groove in blade neck, with thick leading edge to left and thin trailing edge to right as you stand at end of blade. Use a spiral hose clamp or heavy duty plastic wire tie to hold the two blade clamp halves in position on the blade for installation in the hub body (See Figure 1).



Figure 1

INSTALL BLADE INTO HUB

Hoist the blade into position. (Blade and clamp halves weight about 300 lbs.) Slide blade clamp into hub plate. If necessary, use bottle jack to separate hub plates just sufficient for clamp entry, and install four (4) blade studs, eight (8) lock washers and eight (8) nuts (See Figure 2). Tighten lightly.



Figure 2

SET PITCH AND TRACK

Use Hudson EXACT-A-PITCH[®] digital protractor (Shown in Figure 3) or a bubble protractor to set blade pitch. Mount protractor on a flat bar as a base and place it approximately 1" from tip of blade. Note pitch on protractor. Rotate fan 360°, noting high and low pitch readings. Locate place where pitch reading is a mid-point between high and low readings, and set pitch at that point.

Rotate blade in clamp until digital protractor shows specified pitch angle to within $\pm 0.2^{\circ}$. (*Fan pitch angle is shown on fan specification sheet for design duty.*)

After desired pitch angle is set, raise and lower end of fan blade and find mid-point of blade travel. Hold blade at the mid-point. Pull blade back so neck flange sits against blade clamp.

Use torque wrench to tighten clamp bolts to recommended standard of 280 ft-lb (lubricated) or 300 ft-lb (dry). Re-check pitch setting. Blade must be set within $\pm 0.2^{\circ}$ of desired pitch angle. Tighten clamp bolts evenly. **DO NOT OVER-TORQUE CLAMP BOLTS.**

Clamp Bolt Torque Values

Cap Screw Size	Socket Size	Torque Value (ft-lb)							
Size		Lubricated	Dry						
1″ NC	1-5/8″	280	300						



Figure 3

When bolts are tightened, hold a pencil against top end of blade and mark the level onto a fixed object, such as a shop gauge or the fan stack or ring.

Install remaining blades at same position relative to stack or ring as first blade, following procedures above. After tightening bolts, mark top end of each blade in same place first blade was marked. If marks differ by 1-1/2" or more, adjust blade.

CHECK TRACK

After fan is installed in fan ring or stack, outline top end of each blade onto fan ring with a marker. The difference between levels of highest and lowest outlines should not be more than 1-1/2". Correct blade track by loosening clamp bolts and adjusting blade to match track of other blades. Re-tighten bolts and re-check track (See Figure 4) and pitch angle setting. Pull blade back so neck flange sits against blade clamp. Re-tighten blade clamp bolts to recommended standard of 280 ft-lb (lubricated) or 300 ft-lb (dry) torque.



Figure 4

SEAL DISC ASSEMBLY & INSTALLATION

Install self-adhesive rubber gaskets on both flanges of mating seal disc sections. Bolt each pair of sections of seal disc together, using 3/8" NC bolts, flat washer, and lock washer. Torque to 15 ft-lb (lubricated) and 20 ft-lb (dry). (See figure 5 & 6)

If the seal disc adapter ring assembly B7083-n (previously B7053 or B7075/B7054) is provided, install according to figure 7B below.

Position seal disc on top of hub or adapter plate and fasten with six (6) 3/8" cap screws, as shown in figure 7A or 7B. Tighten to recommended standard of 15 ft-lb (lubricated) or 20 ft-lb (dry).

NOTE: The purpose of the seal disc is to prevent hot air from recirculating back down through the hub, increasing efficiency.



Figure 5



Figure 6




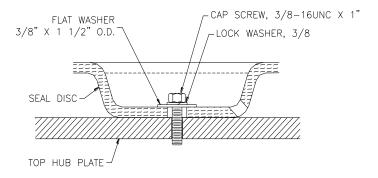


Figure 7 A. For Models without Seal Disc Adapter







1. Locate (6) various mounting holes.

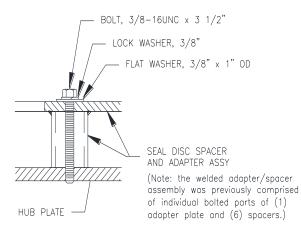


 Install seal disc spacer and adapter assy as shown in above figure at each of the seal disc mounting holes. Torque all bolts to 20-25 ft-lb.





4. Install 1 1/2" OD flat washer on each cap screw.

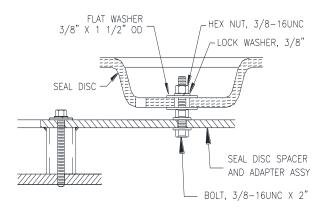

5. Align seal disc with each cap screw. Fasten with flat washers, lock washers and nuts as shown above. Torque all bolts to 20-25 ft-lb.

CHECK TIP CLEARANCE

Rotate fan in position inside fan ring or fan stack to check tip clearance. Check for spots where fan blade clearance is less than 3/4" or greater than 1-1/2" from fan ring (See Figure 8). If necessary adjust fan ring or fan stack by shimming to obtain proper clearance. Note that different cooling towers may have different ways (See Figure 9) to adjust the fan ring or fan stack. As the fan is rotated, check for adequate clearance underneath blade in entire fan swept area.

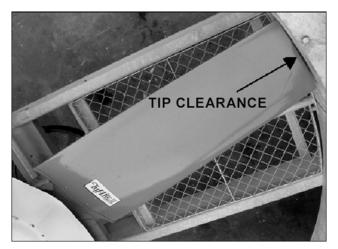


Figure 8


OPERATING INSTRUCTIONS

Initially toggle motor and check fan rotation. Viewed from top, fan blades should rotate clockwise.

Hudson recommends to re-verify the blade clamp torque after the initial 10-15 minutes of cold operation (i.e., the fan doesn't need to be exposed to the working temperature of the process). This will ensure that the blades are settled within the clamps after the centrifugal forces have acted.

Check motor power consumption to be sure fan is pulling desired load. *CAUTION: If positive pitch is set in summer to use all available motor amps (nameplate rating), motor could be overloaded in winter.* Design pitch angles usually do not use all of the available motor horsepower. This ensures that the motors will not be overloaded at low winter temperatures.

For the fans that have remained idle (such as a shut-down or turn-around), it is highly recommended to re-verify the torque on the blade clamps before putting it back into operation.

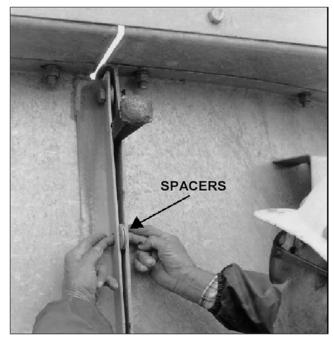




		17	7917 D7237 D7237	D7047 D7047	D7062 D7062	B7060 B7060	N/A N/A	00	00	00	D7073 D7073	16 16	16 16	32 32	84734-5 84736-1	+	1	34	68	136	136	16	16	16	4	8	4
		16	7916 7 D7236 D7 D7236 D7	D7046 D7 D7046 D7	D7062 D7 D7062 D7		N/A N/A		00		D7073 D7	16 16	16 16	32 32		+	1	32	64	128 1	128 1	16	16	16	4	8	4
		1						00	00					<i>.</i>		-	-	ŝ	9			1	-	1	4	ω	4
		15	7915 D7235 D7235	D7045 D7045	D7062 D7062	B7060 B7060	A/N N/A	00	00	00	D7073 D7073	16 16	16 16	32 32	84734-5 84736-1	1	-	30	60	120	120	16	16	16	4	∞	4
		14	7914 D7134 D7234	D7124 D7044	D7062 D7062	B7019 B7060	N/A N/A	00	00	00	D7072 D7073	16 16	16 16	32 32	84734-4 84736-1	٢	1	28	56	112	112	16	16	16	4	8	4
	EMBLY	13	7913 D7133 D7233	D7123 D7043	D7030 D6022	B7019 73045	N/A B7083-3	0 9	0 9	09	D7072 D7071	16 16	16 16	32 32	84734-4 84040	Ł	٢	26	52	104	104	16	16	16	4	8	4
meter	R HUB ASS	12	7912 D7132 D7232	D7222 D7042	D6102 D6022	D6101 73045	B7083-2 B7083-3	99	99	6 6	N/A D7071	0 16	0 16	0 32	84734-3 84040	1	1	24	48	96	96	16	16	16	3	9	3
id 36' Dia	ITEM QUANTITY PER HUB ASSEMBLY	11	7911 D7131 D7231	D7121 D7041	D6102 D6022	D6101 73045	B7083-2 B7083-3	99	0 O	6 6	N/A D7071	0 16	0 16	0 32	84734-3 84040	1	1	22	44	88	88	16	16	16	3	9	с
vTION ly 34' and	ITEM QU	10	7910 D7130 D7230	D7120 D7040	D7022 D6022	B7019 73045	N/A B7083-3	0 9	0 9	0	N/A D7071	0 16	0 16	0 32	84734-2 84040	1	1	20	40	80	80	16	16	16	3	9	ю
ORPOR/ Assemb		6	7909 D7129 D7229	D7119 D7039	D7022 D6022	B7019 73045	N/A B7083-3	0 9	0 9	0 9	N/A D7071	0 16	0 16	0 32	84734-2 84040	٦	1	18	36	72	72	16	16	16	3	9	з
UCTS C itch Fan		8	7908 D7128 D7228	D7118 D7038	81126S D6022	73030 73045	B7083-1 B7083-3	99	99	6 6	N/A D7071	0 16	0 16	0 32	84734-1 84040	1	1	16	32	64	64	16	16	16	3	9	з
UDSON PRODUCTS CORPORATION - Adjustable Pitch Fan Assembly 34' and 36' Diameter		7	7907 D7127 D7227	D7117 D7037	81126S D6022	73030 73045	B7083-1 B7083-3	99	o o	6 6	N/A D7071	0 16	0 16	0 32	84734-1 84040	1	1	14	28	56	56	16	16	16	3	6	3
HUDSOI Ib - Adju		9	7906 D7126 D7226	D7116 D7036	81126S D6022	73030 73045	B7083-1 B7083-3	99	9 9	9 9	N/A D7071	0 16	0 16	0 32	84734-1 84040	1	1	12	24	48	48	16	16	16	3	9	ю
HI 7000 Series Hub	PART NO.	No. of Blade	Hub Assy Part No. Part No.	Part No. Part No.	Part No. Part No.	Part No. Part No.	Part No. Part No.	66216	73722	73623	Part No. Part No.	15349	73730	73719	Part No. Part No.	D7737C	Specify Bore	65018 (Varies)	70643	57402	73742	57027	73720	73739	59547	16716	73738
2000		Fan Size	34H7 36H7	34H7 36H7	34H7 36H7	34H7 36H7	34H7 36H7	34H7 36H7	34H7 36H7	34H7 36H7	34H7 36H7	34H7 36H7	34H7 36H7	34H7 36H7	34H7 36H7			ast Iron									
	DESCRIPTION		Up to 7.44 Dia. Shaft (W-2 Type)	Hub Plate (W-2 Type) (2 Per Hub)	Seal Disc Assy Kit*	Seal Disc Joint Gasket* (2 Per Seal Disc)	SD Adapter/Spacer Assembly** (1 per hub)	SD Spacer Bolt, 3/8"-16 x 3-1/2" w/ nut (316 SS)	SD Spacer Lock Washer 3/8" (316 SS)	SD Spacer Flat Washer 3/8" x 1" OD (316 SS)	Stiffener Ring (1 per hub)	Stiff. Ring Bolt, 5/8"-11 X 2" w/nut (HDG)	Stiff. Ring Lock Washer 5/8" (HDG)	Stiff. Ring Flat Washer 5/8" (316 SS.)	Tuf-Lite II ^O Fan Blade (White) ***	Hub Spool (W-2 Type)	Bushing (W-2 Type)	Blade Clamp Half Standard: Powder Epoxy Coated Gray Cast Iron Optional: Customer Specified Coating of Gray Cast Iron	Blade Clamp Stud W/ 2 Nuts 1"-8 x 14 1/2" (HDG)	1" Flat washer (HDG)	1" Lock washer (HDG)	Hub Spool Cap Screw 3/4"-10 x 2 1/2" (316 SS)	3/4" Flat washer (316 SS)	3/4" Lock washer (316 SS)	Eye Bolt W/ Nut 3/4"-10 x 2" (HDG)	3/4" Flat Washer (HDG)	3/4" Lock Washer (HDG)
	ITEM			٢	2	ю	4	5	9	7	8	6	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24

* Seal Disc Assy Kit includes Gaskets and all hardware (316 SS) to assembly and mount. ** The welded assemblies B7083-1, -2 & -3 were previously comprised of individual bolted parts of one B7073, B7075 or B7070 ring and six B7054 spacers, *** Blade color was blue prior to March 2006.

PART LIST

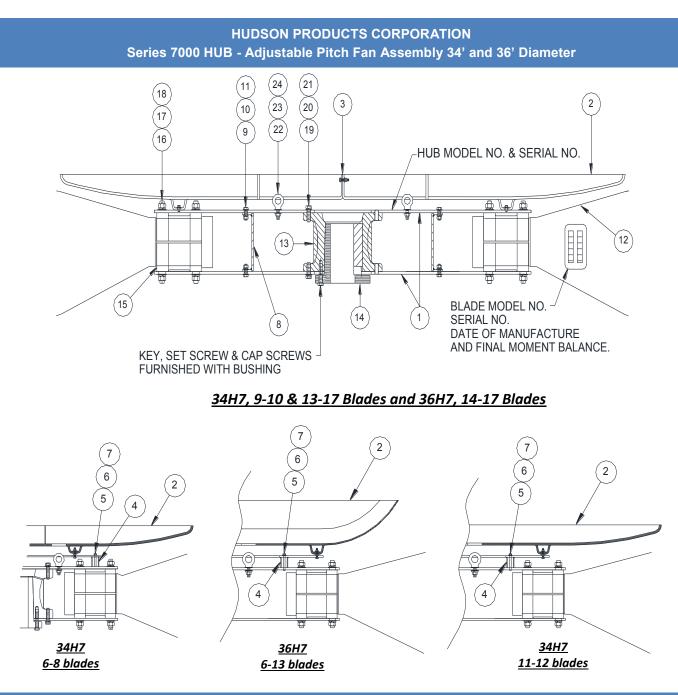

STANDARD MATERIALS & FINISHES

Blades: Fiberglass reinforced vinyl ester Hub Spool: Ductile Iron, Coal Tar Epoxy coating Plates: Coal Tar Epoxy coated steel Bushing: Malleable Iron Seal Disc: Fiberglass Reinforced Polyester

Blade Clamps:

Powder Epoxy Coated Ductile Iron Standard Fasteners: Steel, HDG & 316 SS Opt. Complete Fan with 316 SS (Option 1) Complete Fan with K500 Monel (Option 2)

WHEN ORDERING, SPECIFY FAN DIAMETER, TYPE & NUMBER OF BLADES & SHAFT DIAMETER

EXAMPLE:

APT

Fan Model Adjustable Pitch

Fan Diameter & Blade Type (Specify "H7" for Tuf-Lite II[®] Blades 7000 Series)

34H7

Number of Blades

10

6 1/2" BORE

Shaft Diameter



9660 Grunwald Rd. Beasley, Texas 77417-8600 Phone: 281-396-8100 Fax: 281-396-8388 1-800-634-9160 (24 Hours) EMAIL: hudsonproducts@hudsonproducts.com http://www.hudsonproducts.com

Hudson, Auto-Variable, Combin-Aire, Exact-A-Pitch, Fin-Fan, Heatflo, Hy-Fin, Split-Flo, Solo Aire, Stac-Flo, Steamflo, Thermflo, Tuf-Edge, Tuf-Lite, Tuf-Lite II, and Tuf-Lite III are registered trademarks of Hudson Products Corporation.

©2012 Hudson Products Corp. All Rights Reserved.