

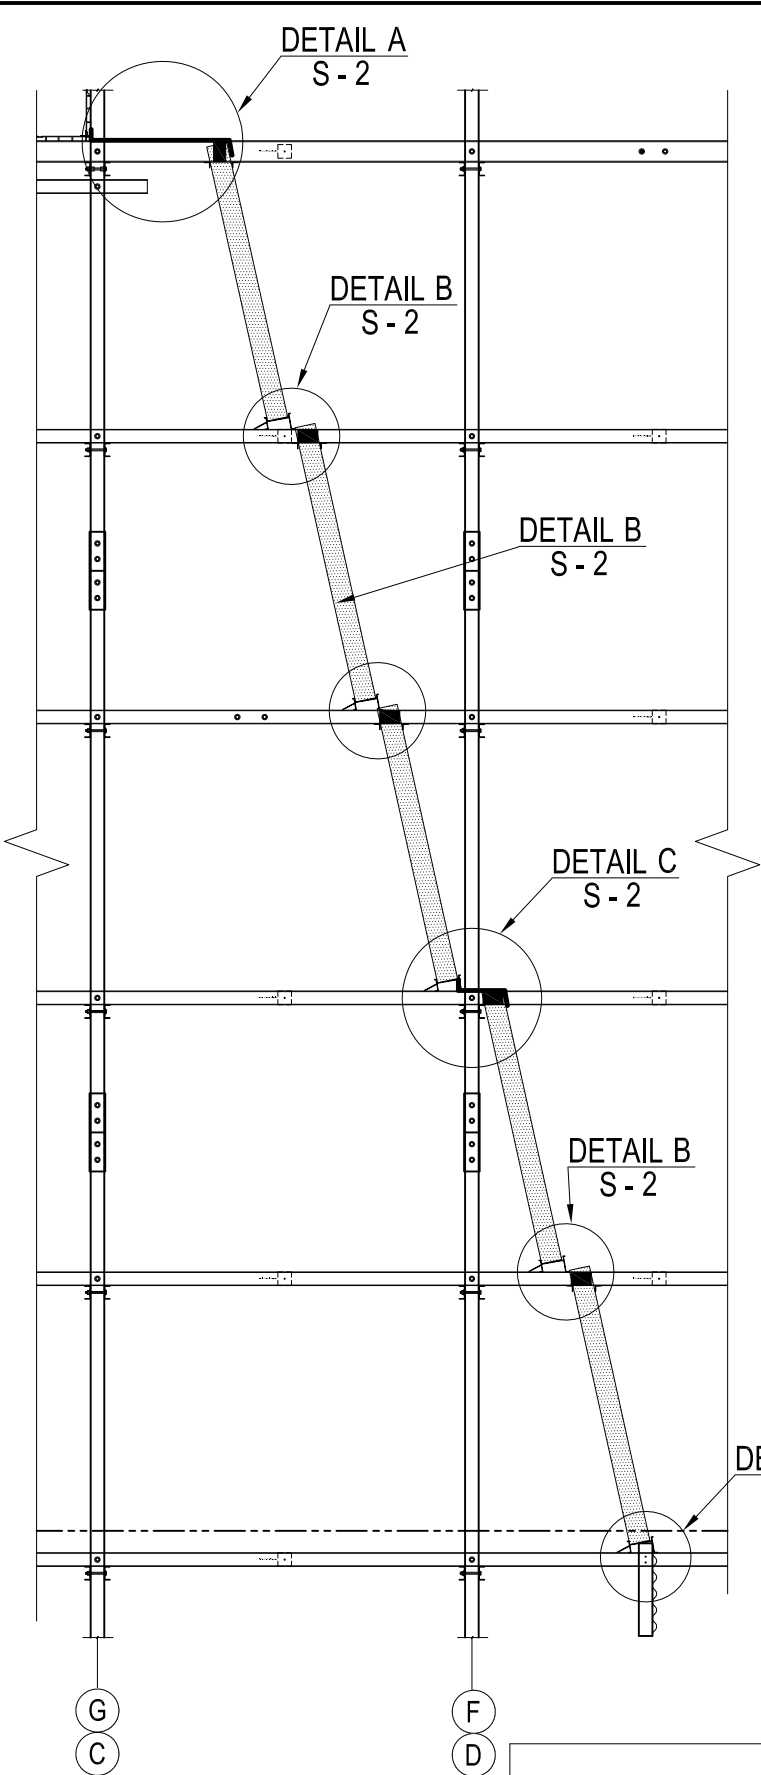


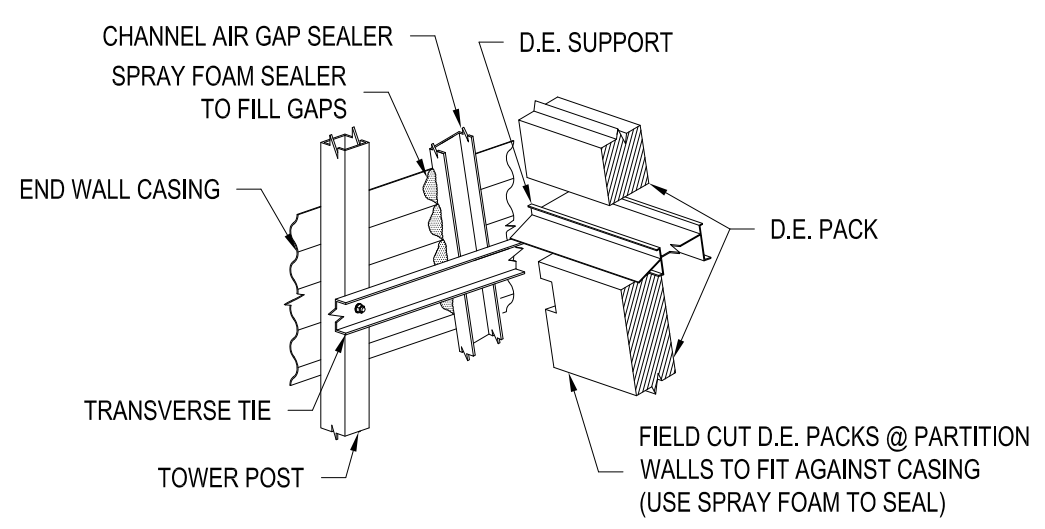

TRANSVERSE VIEW

FOAM SEALER INSTALLATION DETAIL

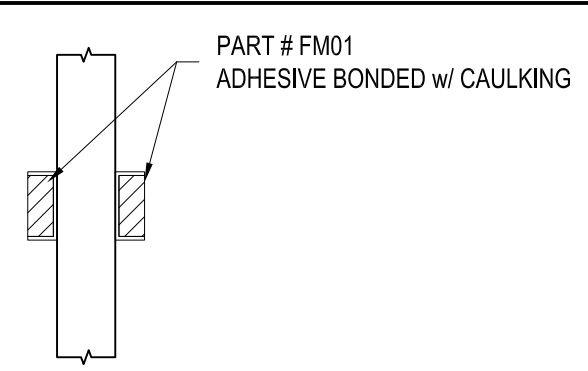

DRIFT ELIMINATOR INSTALLTION DETAIL

MATERIAL SCHEDULE					
PART #	QTY REQ'D	QTY TO SHIP	MAT 'L	DESCRIPTION	
AS34238	46	46	FRP	3 1/2" x 3 1/2" x 1/4" x 1'-11 3/4" TUBE	-
-	16	16	FRP	4.2, 12 oz. x 1'-9" x 12'-6" CASING AIR SEAL	-
BDES01	22	22	FRP	8'-0" x 2'-11 11/16" x 1/4" DE TOP SHELF	-
BDES02	44	44	FRP	4'-0" x 1'-0 1/4" x 1/4" DE INTERMEDIATE SHELF	-
FM01	460	470	FOAM	3 1/2" x 5 1/8" x 1 5/16" FOAM SEALER	-
DS345SS	46	46	304 SS	10" x 9" (16 ga.) DRI-SEAL	-
DS343SS	184	184	304 SS	10" x 7" (16 ga.) DRI-SEAL	-
-	10	10	-	DOW (GREAT STUFF GAPS & CRACKS) FOAM SEALER (12oz CAN)	-
HARDWARE SCHEDULE					
PART #	QTY REQ'D	QTY TO SHIP	MAT 'L	DESCRIPTION	
-	3000	3,000	304 SS	#12 x 1 1/2" HEX HEAD SELF DRILLING SCREW	-
-	92	100	304 SS	1/4" x 4 1/2" BOLT (W/ 1 NUT, 2 FLAT WASHERS, AND 1 LOCK WASHER)	-
-	40	40	-	VULKEM CAULK	-

NOTE: D.E. MEDIA MIL THICKNESS AS SPECIFIED ARE AFTER FORMING ALL VERTICAL JOINTS, GAPS ARE TO BE FULLY CAULKED

REVISIONS				
DATE		DESCRIPTION	BY	CHECK
2-29-2016		INITIAL ISSUE		




STAR COOLING TOWERS LP


9007 FM 2759
RICHMOND, TX 77469
PH. 713 645-3323
FAX 713 645-3029

1000 W. MCNAB RD, SUITE 236
POMPANO BEACH, FL 33062
PH. 954 532-0177
FAX 954 532-0351

PROJECT:			
LOCATION:			
DRAWING TITLE: DRIFT ELIMINATOR INSTALLATION & DETAILS			
PROJECT NO. 160325		DRAWN BY: RC	CHECKED BY: TTH
DWG. # D210		Scale: NONE	SHEET: 1 OF 2

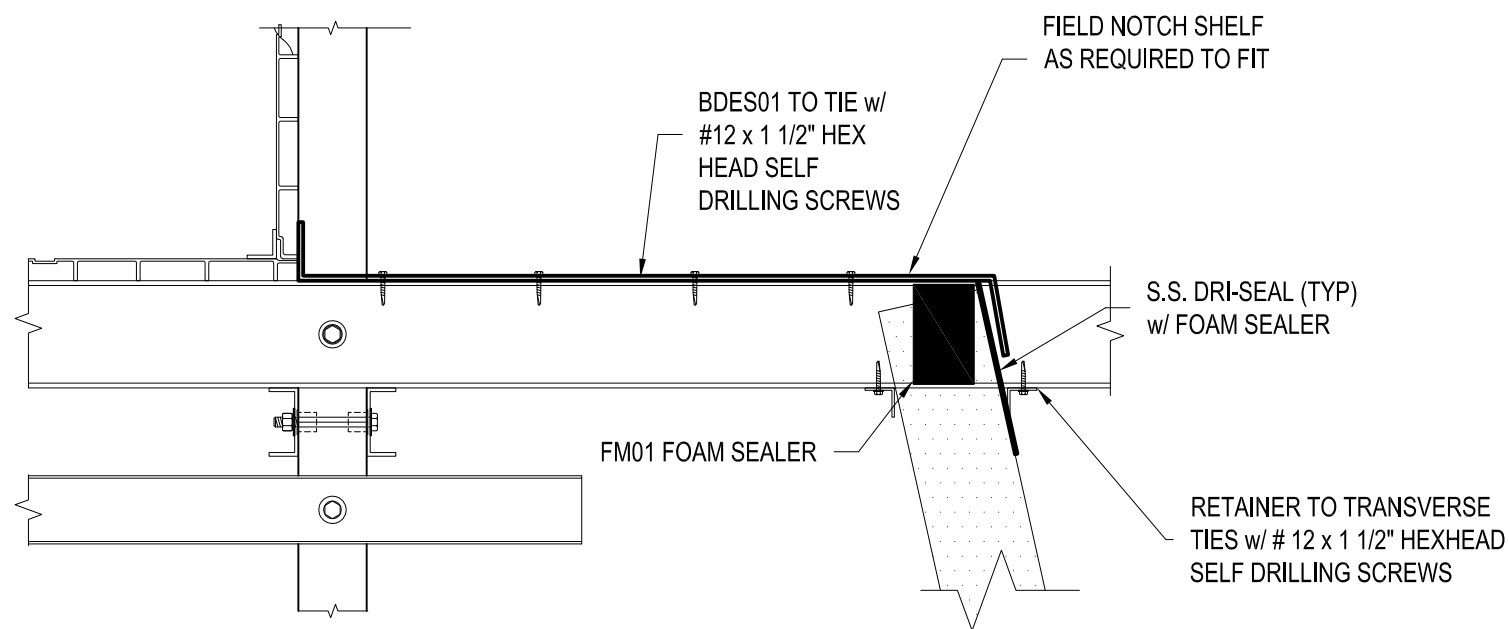


DETAIL A

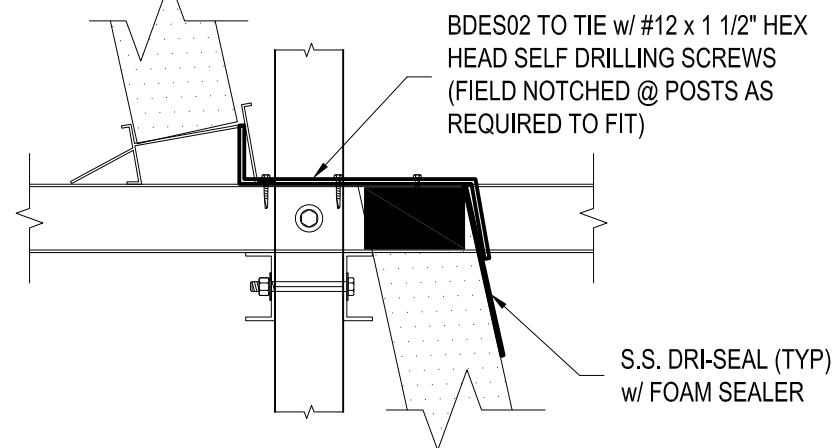


DETAIL C

DE TRAY ATTACH TO TRANSVERSE TIE w/ # 12 x 1 1/2" HEXHEAD SELF DRILLING SCREW (2 PER TIE LINE LOCATION TYP.)

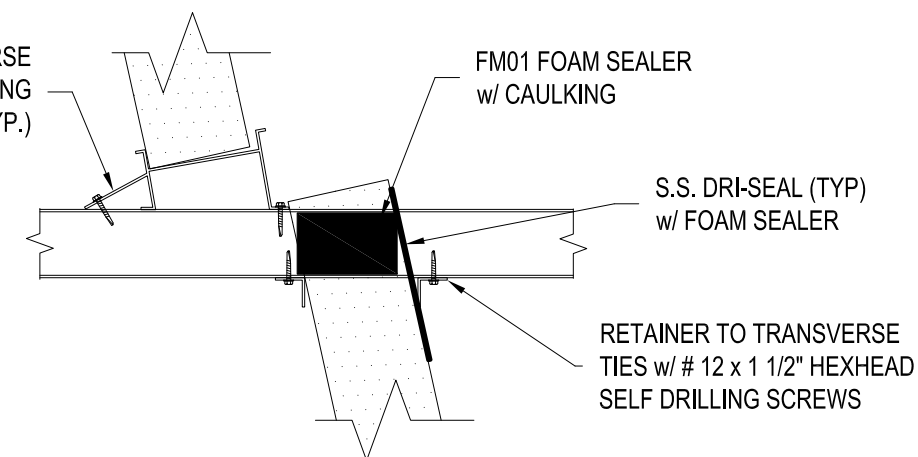

DETAIL B

PART # AS34238 AIR SEAL SUPPORT TO TRANSVERSE TIES w/ 1/4" Ø x 4 1/2" BOLT w/ NUT, LOCK & FLATWASHER

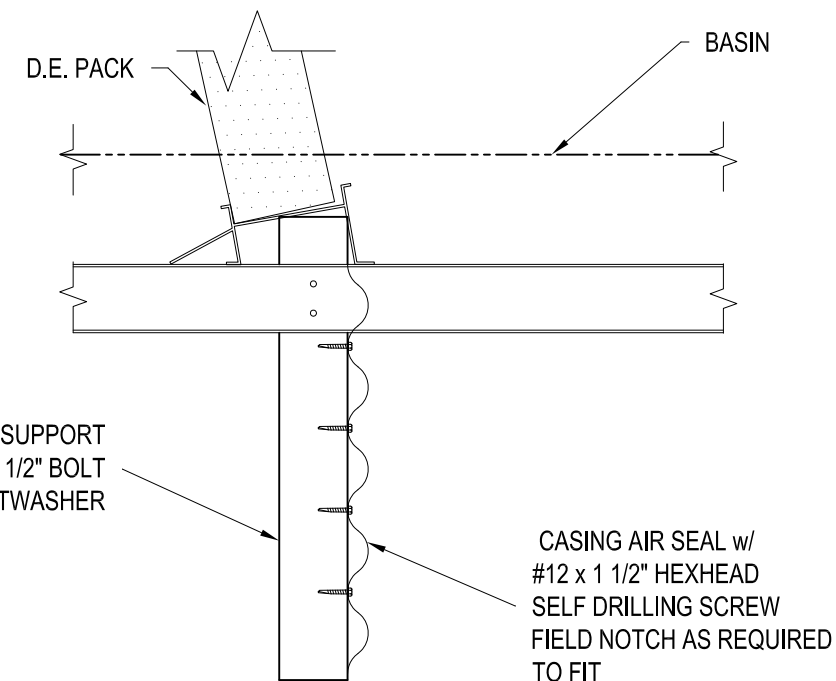

DETAIL D

REVISIONS					
DATE			DESCRIPTION	BY	CHECK
2-29-2016			INITIAL ISSUE		



STAR COOLING TOWERS LP

9007 FM 2759
RICHMOND, TX 77469
PH. 713 645-3323
FAX 713 645-3029

1000 W. MCNAB RD, SUITE 236
POMPAÑO BEACH, FL 33062
PH. 954 532-0177
FAX 954 532-0351

PROJECT:

LOCATION:

DRAWING TITLE: DRIFT ELIMINATOR INSTALLATION & DETAILS

PROJECT NO. 160325

DRAWN BY:
RC


CHECKED BY: TTH

DWG. # D210

Scale: NONE


SHEET: 2 OF 2

DRIFT ELIMINATORS

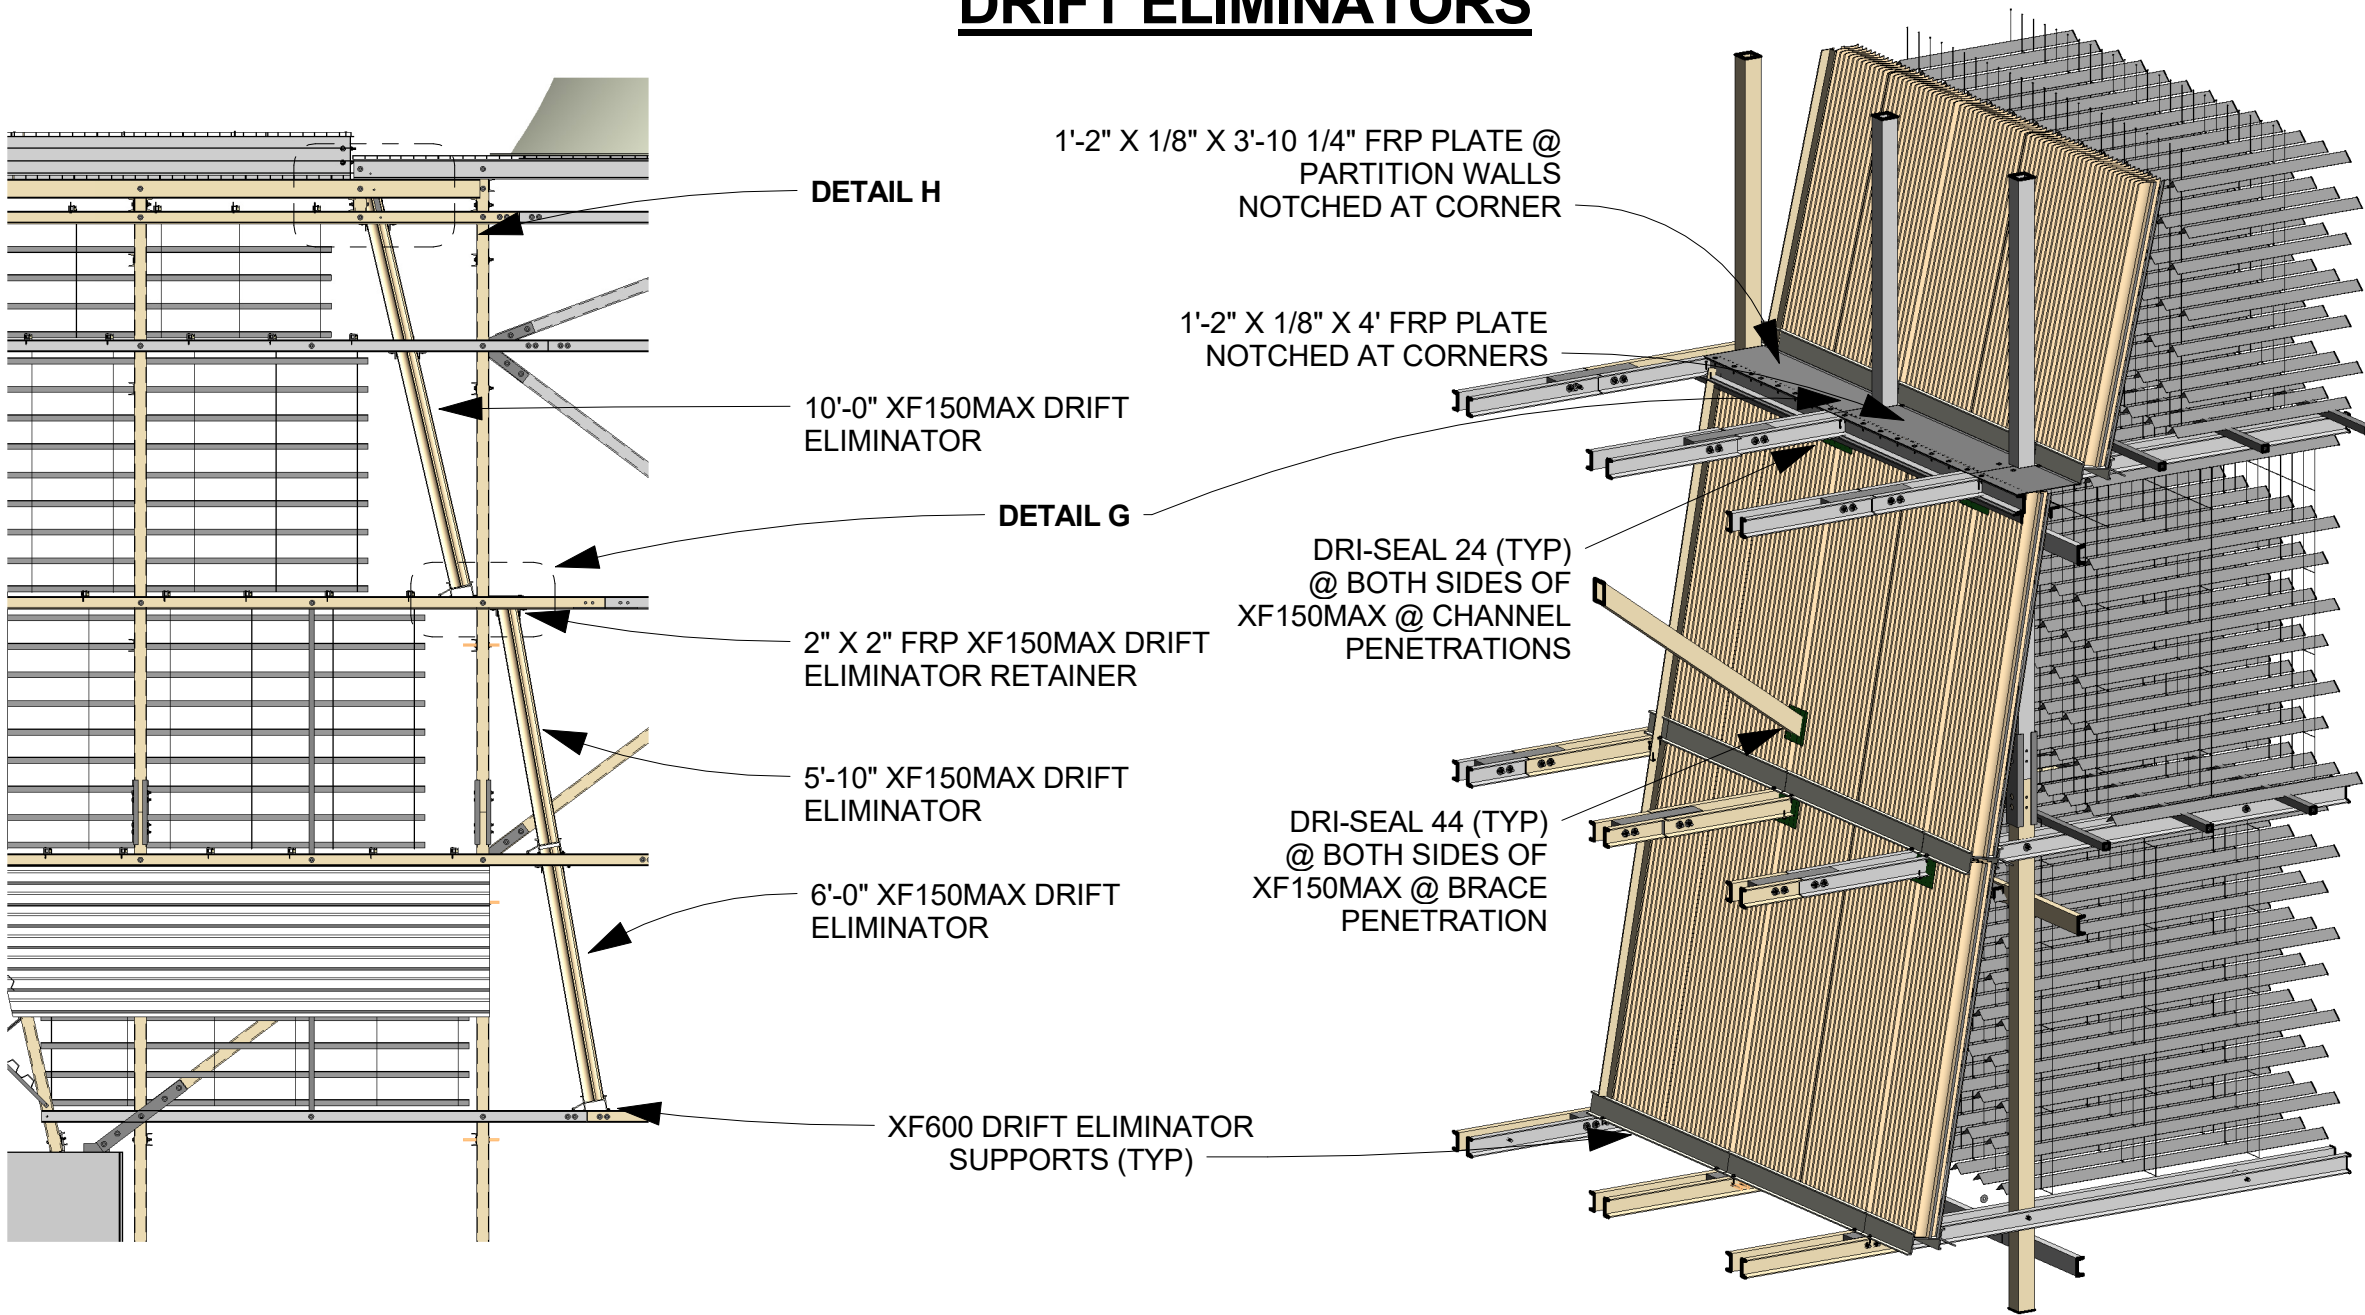

REVISIONS

DATE	LTR	FREQ	DESCRIPTION	BY	CHECK	FREQ
10/29/14						

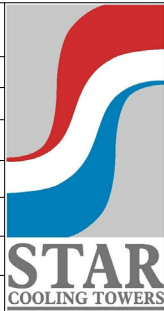


STAR COOLING TOWERS LP

9007 FM 2759
RICHMOND, TX 77469
PH. 713 645-3323
FAX 713 645-3029


1000 W. MCNAB RD, SUITE 236
POMPANO BEACH, FL 33062
PH. 954 532-0177
FAX 954 532-0351

PROJECT DESCRIPTION		
LOCATION: FOR INFORMATIONAL PURPOSES		
- DRIFT ELIMINATORS DETAIL		
PROJECT NO.	DRAWN BY	CHECKED BY
-	SM	DM
Scale 1/4" = 1'-0"		SHEET A-6

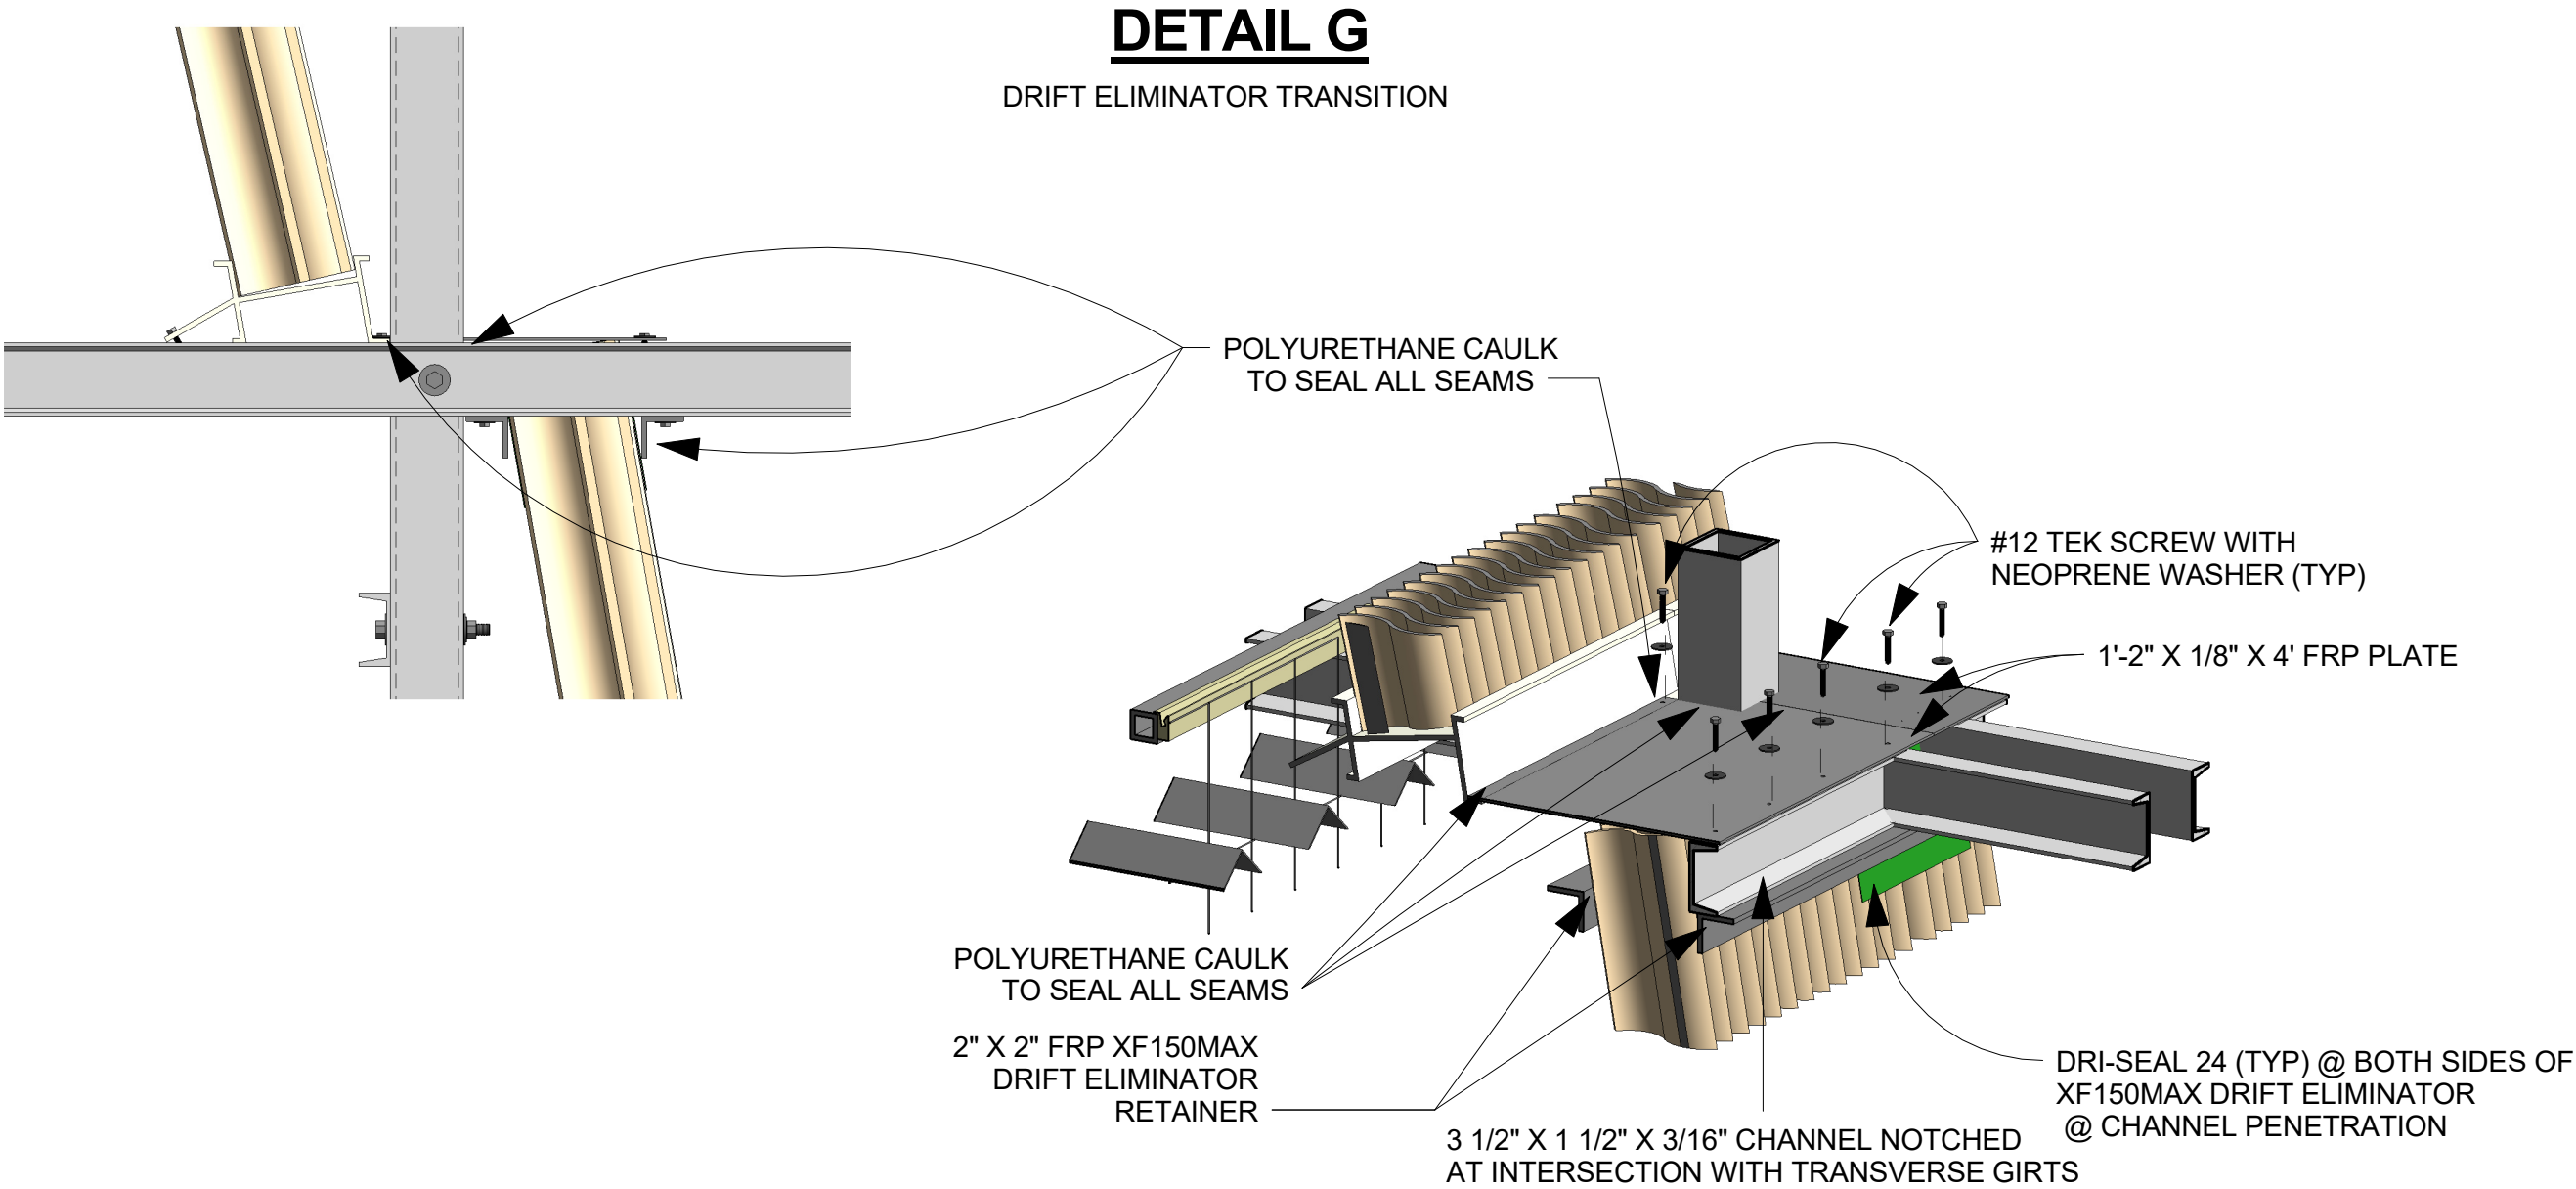

REVISIONS

DATE	LTR	FREQ	DESCRIPTION	BY	CHECK	FREQ
10/29/14						

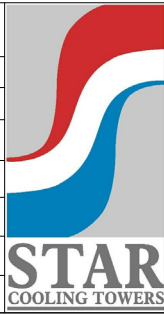


STAR COOLING TOWERS LP

9007 FM 2759
RICHMOND, TX 77469
PH. 713 645-3323
FAX 713 645-3029

1000 W. MCNAB RD, SUITE 236
POMPANO BEACH, FL 33062
PH. 954 532-0177
FAX 954 532-0351

PROJECT DESCRIPTION		
LOCATION: FOR INFORMATIONAL PURPOSES		
- DRIFT ELIMINATOR TRANSITION DETAIL		
PROJECT NO.	DRAWN BY	CHECKED BY
-	-	-
Scale 1 1/2" = 1'-0"		SHEET A-7


CLOSURE STRIPS

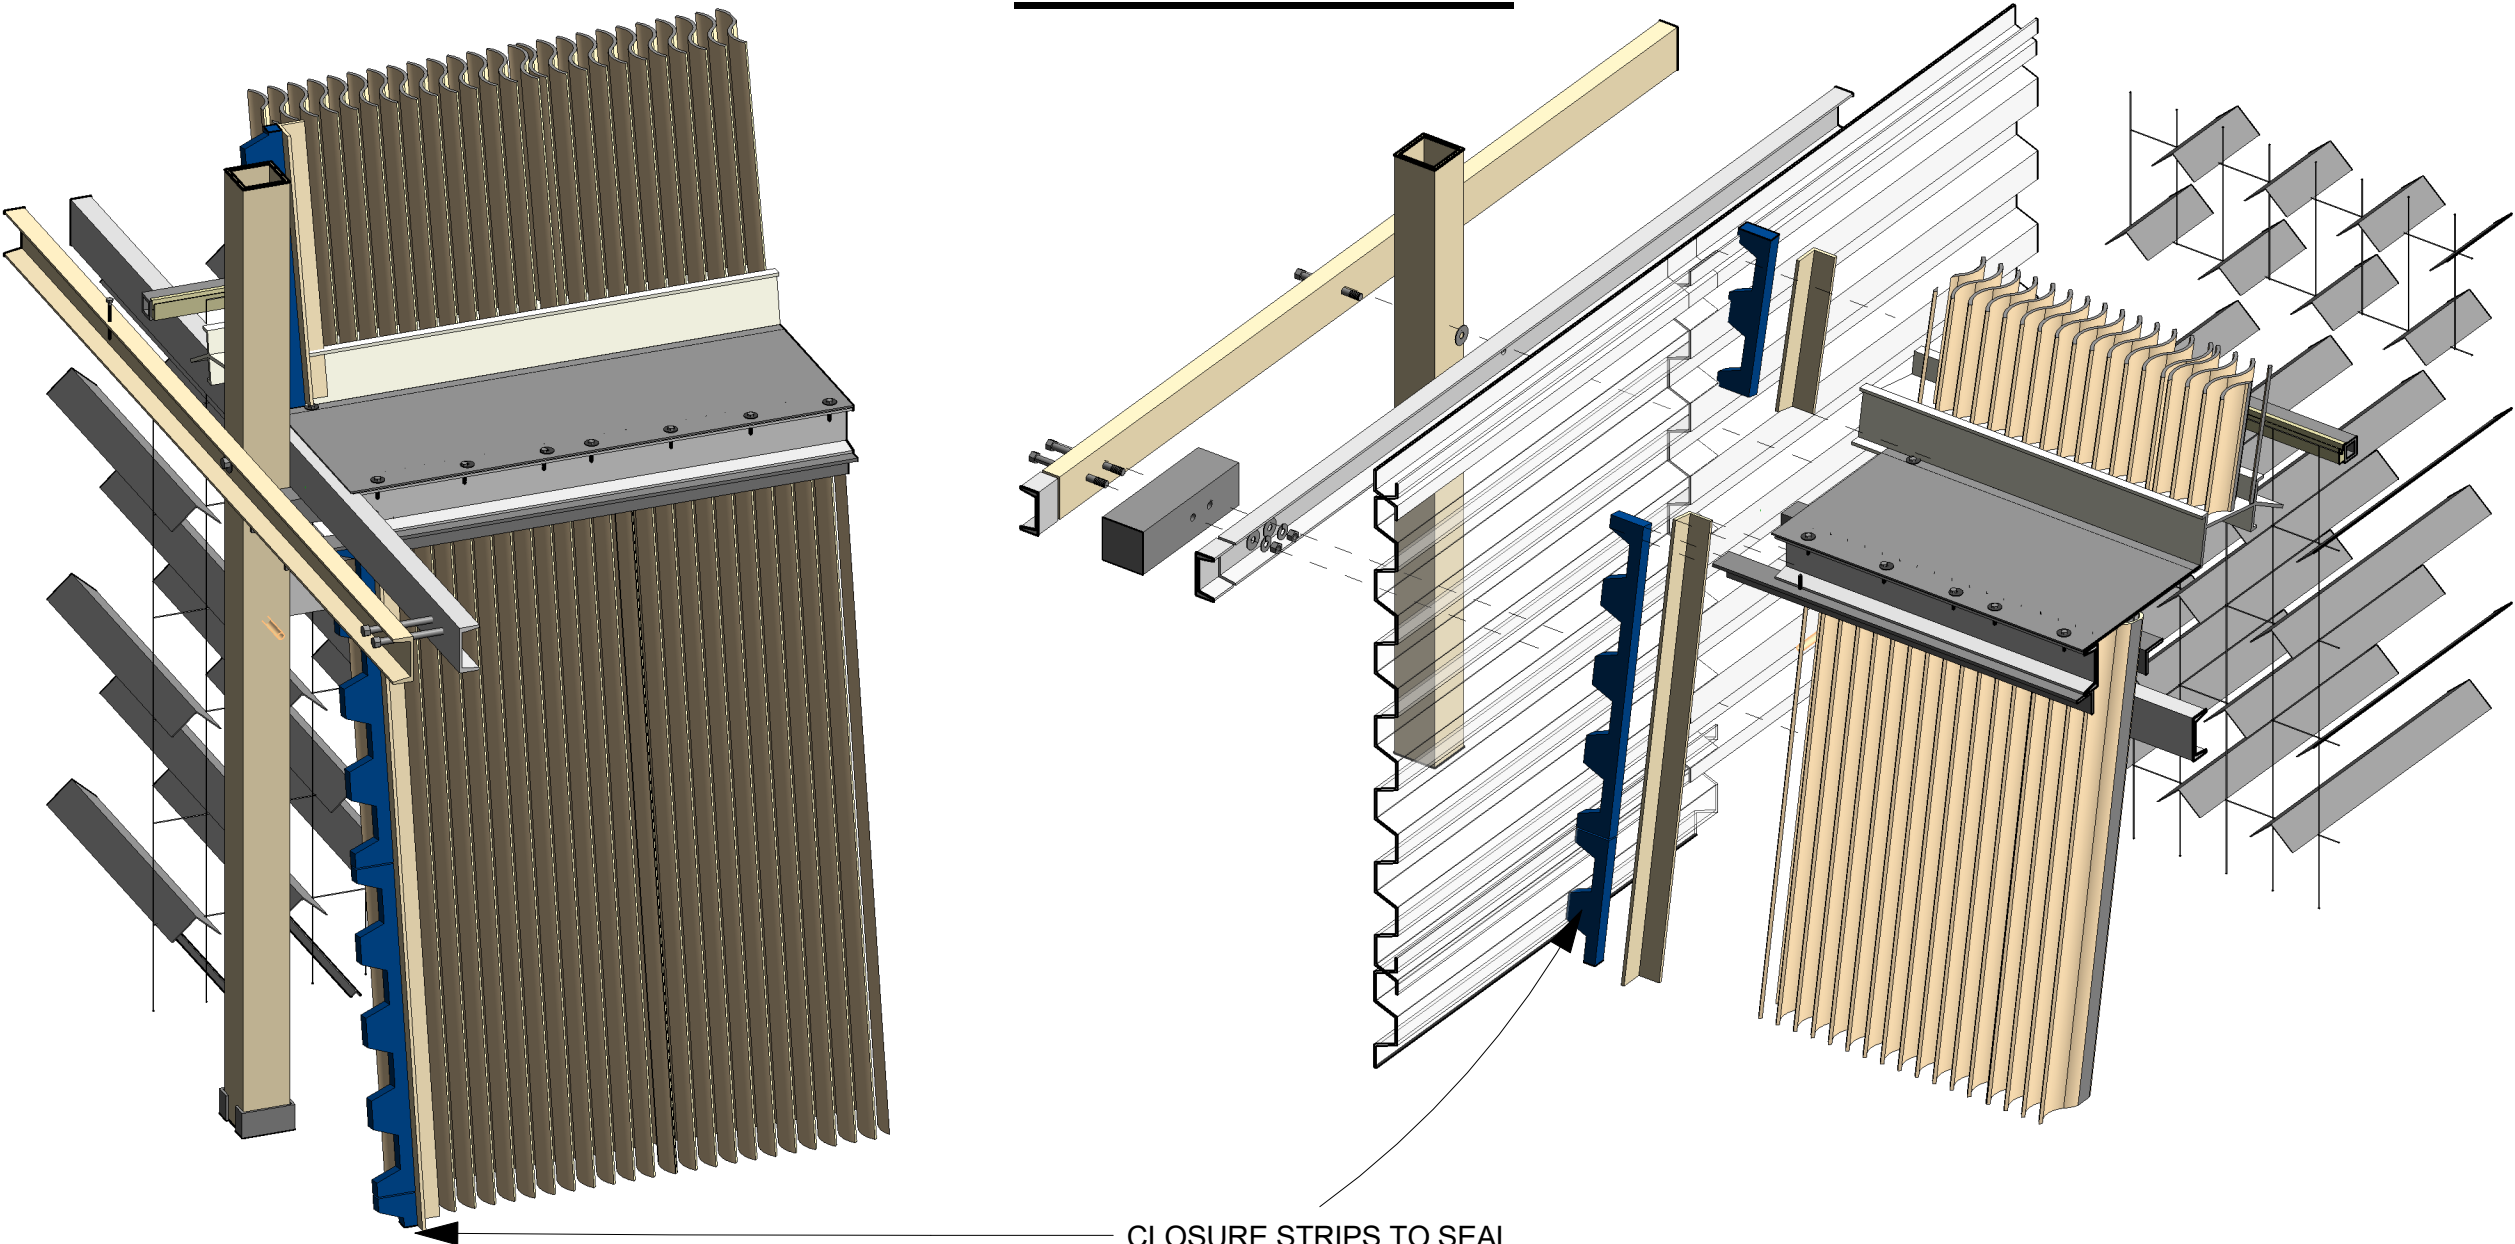

CLOSURE STRIPS TO SEAL
120Z 4.2 PANELS TO XF150MAX DRIFT ELIMINATORS

REVISIONS

DATE	LTR	FREQ	DESCRIPTION	BY	CHECK	FREQ
10/29/14						

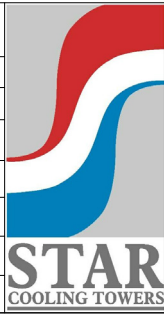

STAR COOLING TOWERS LP

9007 FM 2759
RICHMOND, TX 77469
PH. 713 645-3323
FAX 713 645-3029

1000 W. MCNAB RD, SUITE 236
POMPANO BEACH, FL 33062
PH. 954 532-0177
FAX 954 532-0351

PROJECT DESCRIPTION		
LOCATION: FOR INFORMATIONAL PURPOSES		
- CLOSURE STRIP DETAIL		
PROJECT NO. -	DRAWN BY SM	CHECKED BY DM
Scale		SHEET A-8